




# Philips Sonicare FlexCare UV Light Bulb Replacement

The UV light bulb in the sanitizer will be replaced.

Written By: Tasha Panattoni

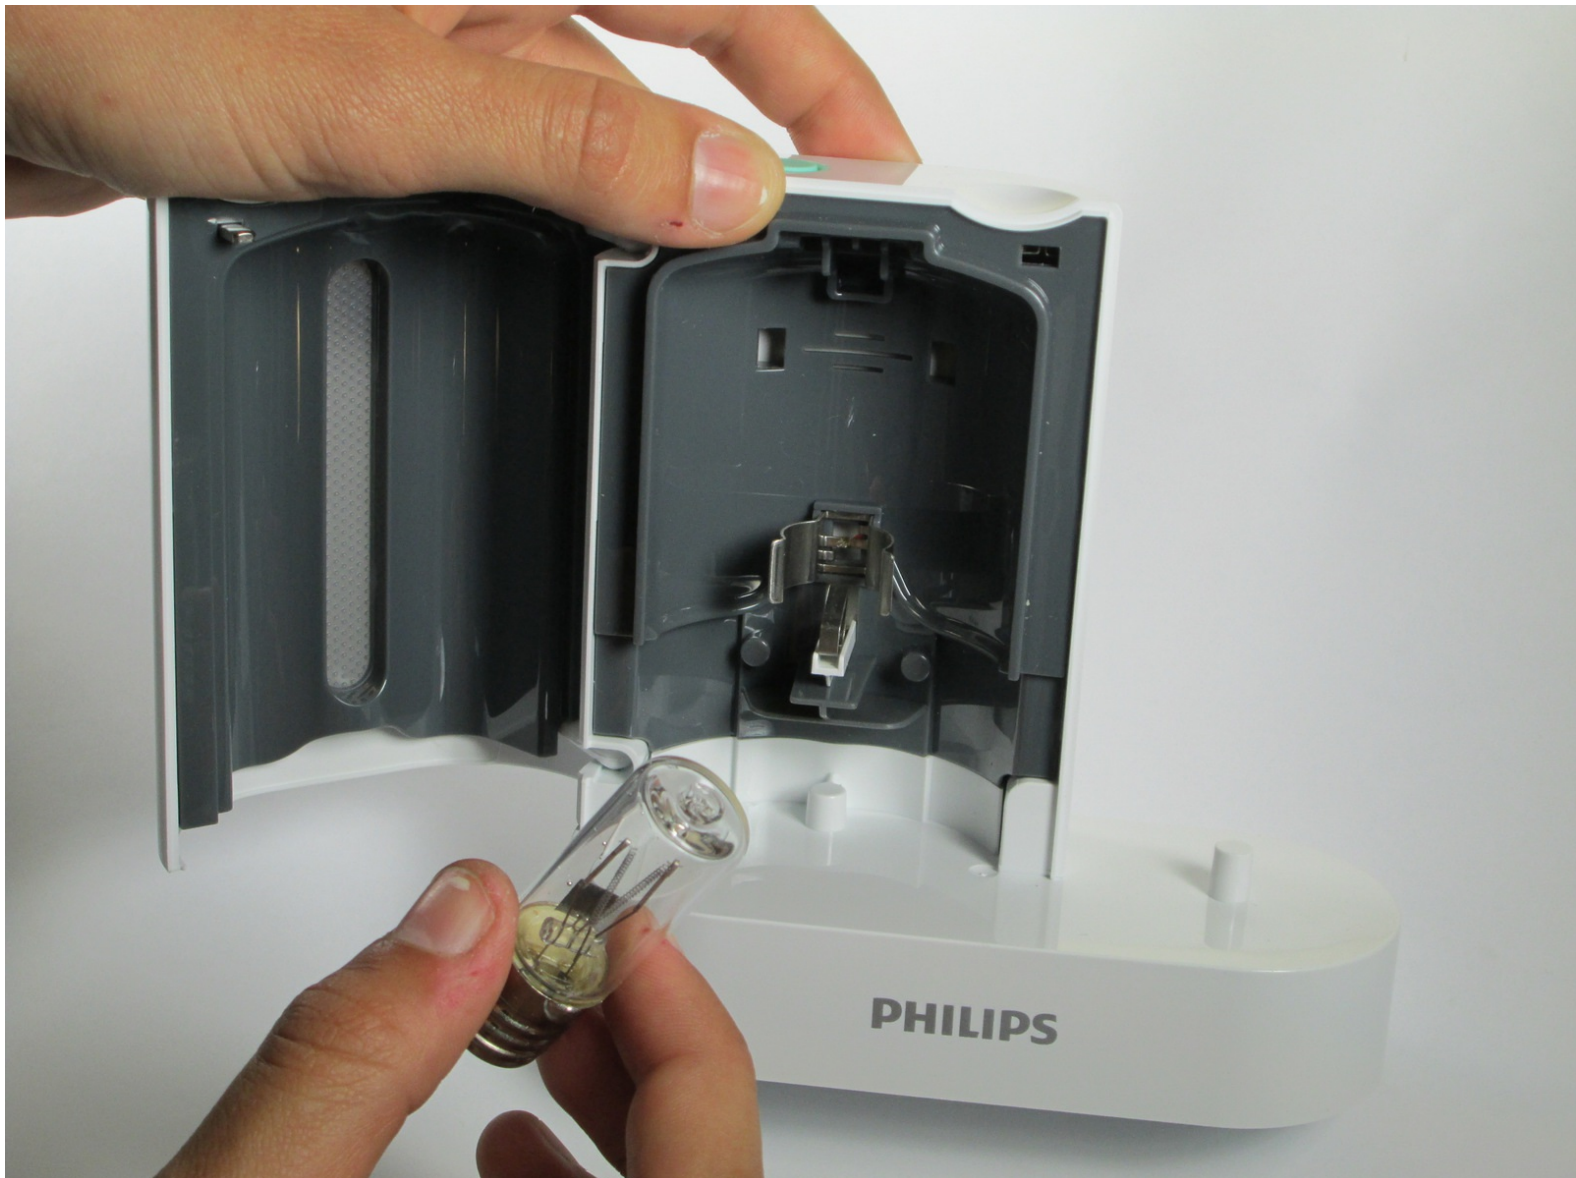

## Step 1 — UV Light Bulb



- Before initiating the process, ensure that the sanitizer is not plugged into an outlet. Swing the door open to expose the interior of the sanitizing device.

## Step 2



- Grip the sides of the plastic cover that is shielding the circuitry. Pull the cover outward to remove it from the sanitizer.





### Step 3



- Squeeze the sides of the guard that is placed over the UV light bulb. Pull the piece outward to remove it.

### Step 4

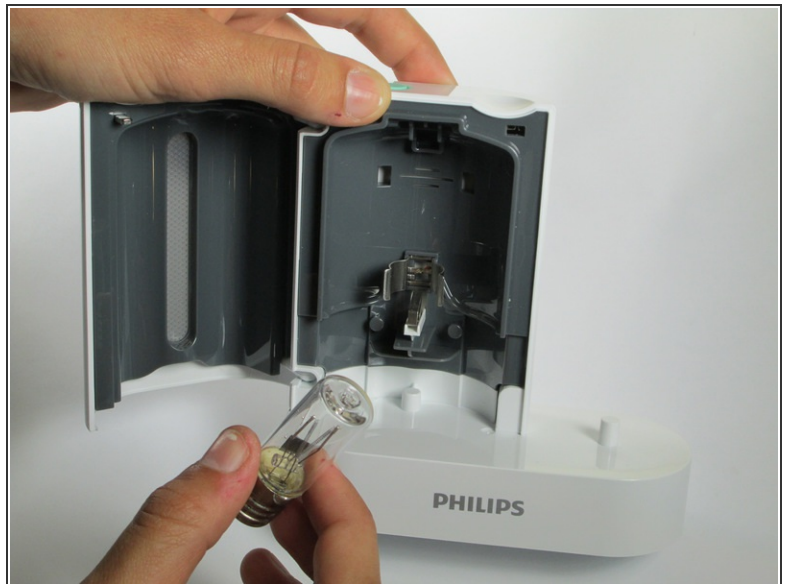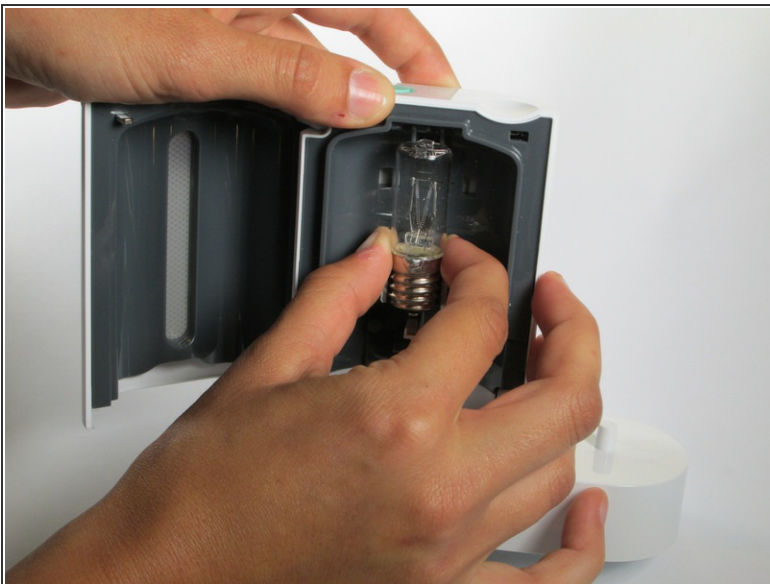

- Before holding the light bulb, ensure that it is not warm due to previous use. Once that is confirmed, take a hold of the light bulb by the threaded surface and rotate it while pulling it outward. Have a compatible UV bulb to replace the old one.

To reassemble your device, follow these instructions in reverse order.

This document was last generated on 2017-06-21 07:20:52 PM.